


The Auckland City Council tests water quality at Piha on a regular basis and the latest results are as follows

Piha North Lagoon	140	E.Coli MPM/100mL	No alert
Piha North Beach	Less Than 10	Enterococci MPM /100 mL.	No alert
Piha main Lagoon and stream	130	E.Coli MPM/100mL	No alert
Piha Beach	Less than 10	Enterococci MPM /100mL.	No Alert
Piha Moana Stream	680	E.Coli MPM/100mL	Red alert

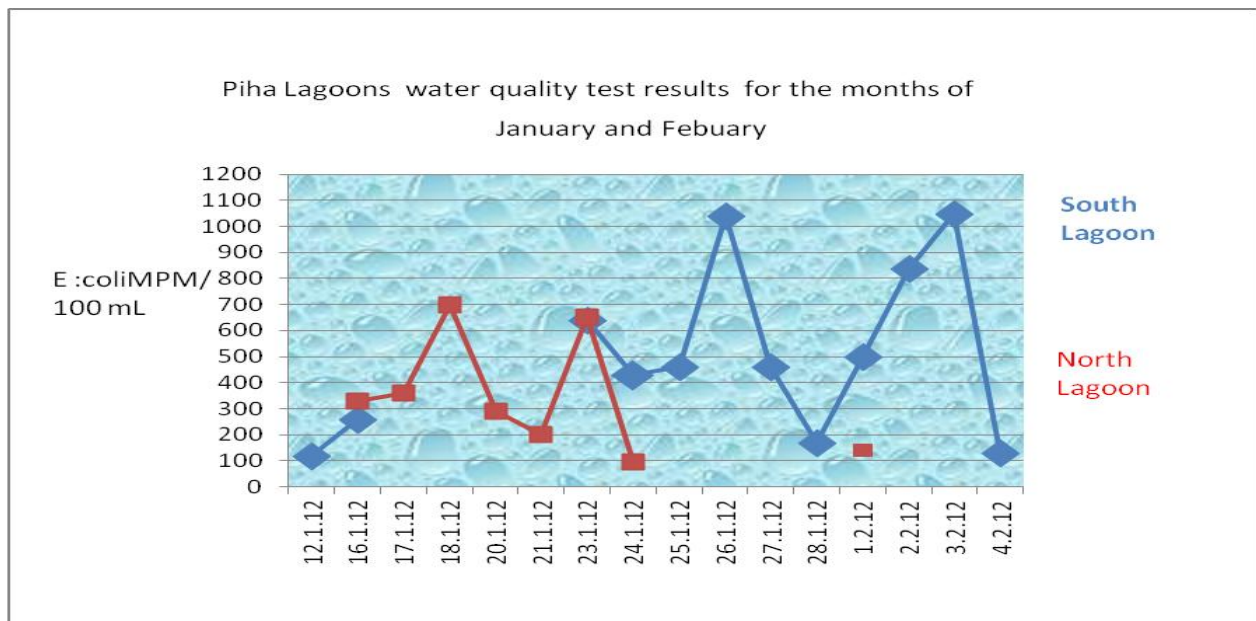

This data is up to -to-date as at 7.2.12.

This report is produced by the Piha R&R Association - [www.piha.org.nz](http://www.piha.org.nz) from data supplied by

